

**A. Input Characteristics:**

- 1) Voltage: 200-250VAC
- 2) Frequency: 50/60 Hz.
- 3) Line Current: 16A Maximum
- 4) Load Capacity: 3.68 KVA
- 5) Overload Protection: (1) 2P/16A UL489 Circuit Breaker
- 6) Power Cord: 10' (3m), #12AWG(3.3mm<sup>2</sup>)/3C
- 7) Connector: IEC309-16A
- 8) Indicator: Power-on, LED

**B. Output Characteristics:**

- 1) Voltage: 200-250VAC
- 2) Current: 16A (Total Combined Load)
- 3) Outlets: 12X IEC C13

**C. Mechanical Characteristics:**


- 1) Material: CRS
- 2) Finish: Powder Coat, Black, Fine Texture
- 3) Lettering: Silk-Screen, White/Epoxy
- 4) Storage Temp.: -(13) - 149F (-25 - 65C)

**D. Operating Environment:**


- 1) Temperature: 32 - 122F (0 - 50C)
- 2) Relative Humidity: 0 - 95% (Non-Condensing)
- 3) Elevation: 0 - 10,000FT (0 - 3000 m)

**E. Regulatory Conformance:**

- 1) Safety Agency: UL/cUL, UL60950-1, CE
- 2) RoHS: Compliant to Directive 2002/95/EC





IEC309-16A

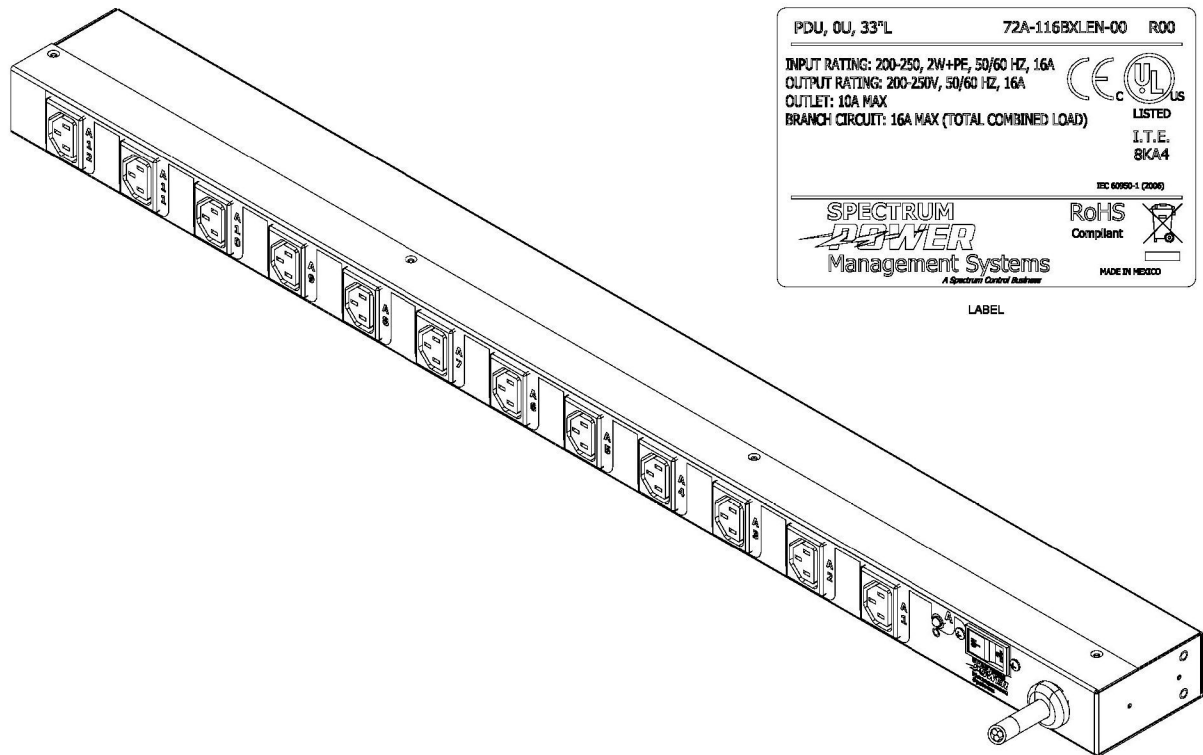

|   |                 |                           |
|---|-----------------|---------------------------|
| PDU, 0U, 33"L   | 72A-116BXLEN-00 | R00                       |
| INPUT RATING: 200-250, 2W+PE, 50/60 HZ, 16A<br>OUTPUT RATING: 200-250V, 50/60 HZ, 16A<br>OUTLET: 12X IEC C13<br>BRANCH CIRCUIT: 16A MAX (TOTAL COMBINED LOAD) |                 |                           |
|   |                 | LISTED<br>I.T.E.<br>8KAA4 |
| SPECTRUM<br><b>POWER</b><br>Management Systems<br><small>A Spectrum Control Systems</small>   |                 | RoHS<br>Compliant<br>     |
| IEC 60950-1 (2006)<br>MADE IN MEXICO  |                 |                           |

LABEL

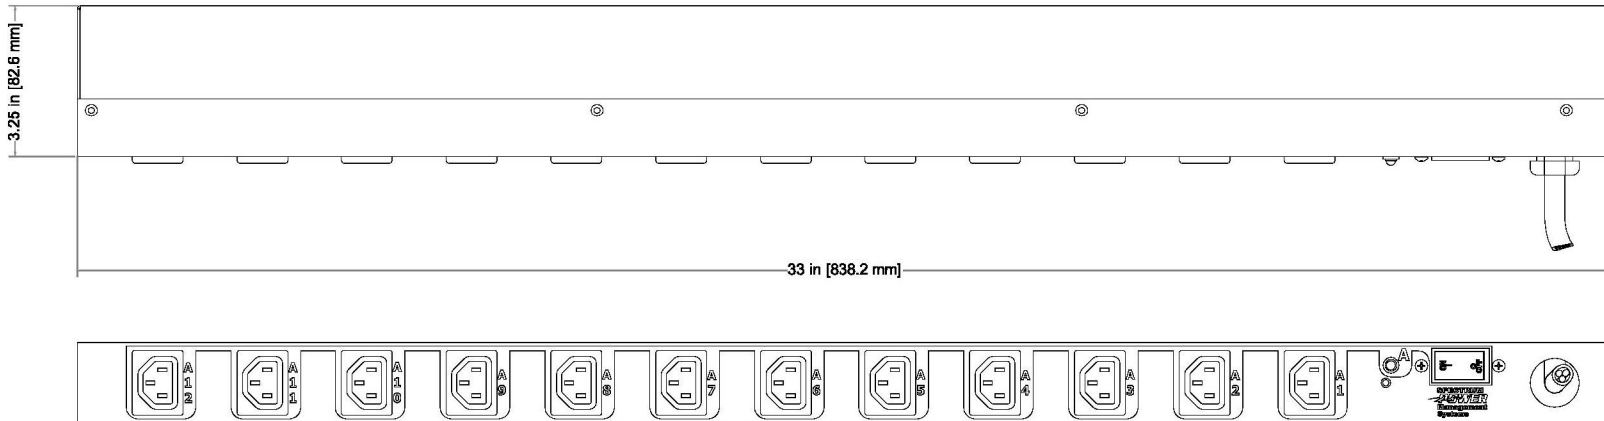

|                            |  |  |  |  |                        |  |  |                |  |
|----------------------------|--|--|--|--|------------------------|--|--|----------------|--|
| 40243-ENG<br>CHANGE NOTICE | DRAWINGS IN ACCORDANCE WITH STANDARD ANSI Y14.6M-1994<br><br>THIS DOCUMENT CONTAINS PROPRIETARY INFORMATION AND IS COPYRIGHTED. EXCEPT WITH THE WRITTEN PERMISSION OF SPECTRUM CONTROL, INC. OR ITS SUBSIDIARIES, SUCH INFORMATION SHALL NOT BE PUBLISHED OR DISCLOSED TO OTHERS, OR USED FOR ANY PURPOSE AND THIS DOCUMENT SHALL NOT BE DUPLICATED IN WHOLE OR IN PART. |  | TOLERANCES UNLESS OTHERWISE SPECIFIED:<br>FRACTIONS ±1/64<br>DECIMAL .XX ± .020<br>DECIMAL .XXX ± .010<br>ANGLES ± 0°30' |  | THIRD ANGLE PROJECTION | Spectrum<br><b>POWER</b><br>Management Systems |  |                |  |
|                            | DRAWN: CarrS   |  | DATE: 2/22/2008  |  |                        | SHEET: 1 OF 1                                  |  | CODE IDENT NO: |  |
|                            | STATE COLLEGE, PENNSYLVANIA  |  | 72A-116BXLEN-00  |  |                        | 12X C13, 1 BREAKER, 0U PDU                     |  |                |  |